
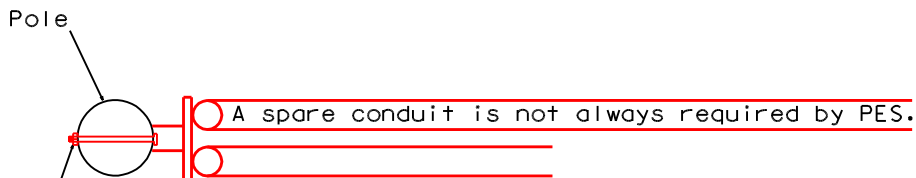


Owner/Developer is to open and close all ditches.  
 O/D is to furnish and install all conduit in ditch (3" SCH80).  
 O/D is to furnish and install all sweeps (3" Galv. - 36" Radius).  
 O/D is to furnish all riser material and install first 10' beyond conduit vent. (Riser Material - 3" Galv.)  
 O/D is to furnish and install grounding clamps at or below first stand-off bracket.  
 O/D is to furnish and install pull rope (1/4" or larger).

PES will install remaining material to complete construction of Primary Riser.

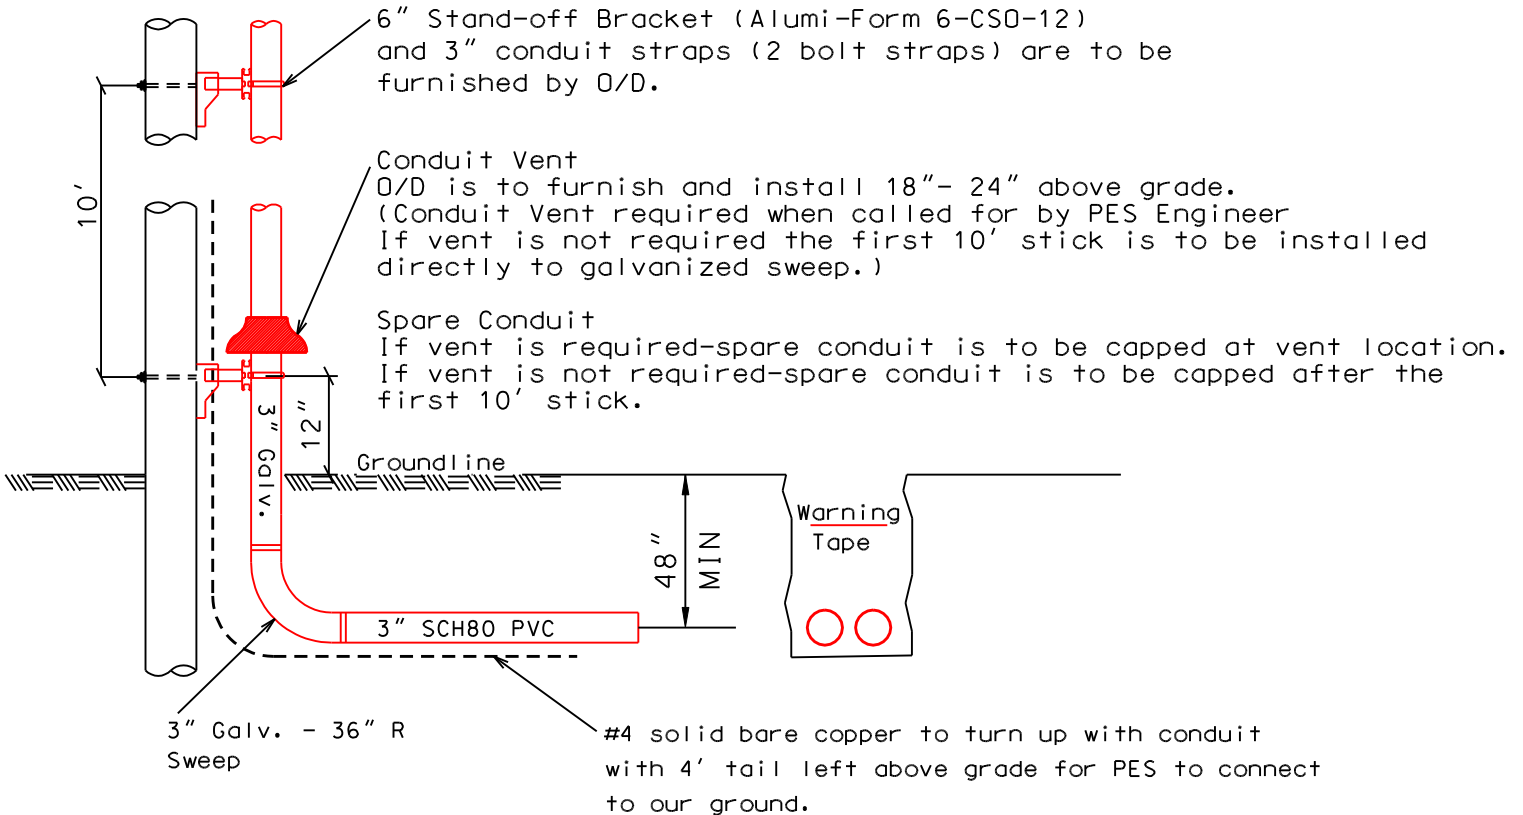

A 5/8" through bolt is required for stand-off bracket.

#### Notes:

If the ditch does not reach the required depth, conduit is to be covered with 6" of concrete.

If the ditch crosses another utility, PES is to be located in the lower position and 6" of concrete separation is required. The concrete is to extend 18" either side of the crossing.

NO ditch can be covered until PES has performed an inspection and pulled a warning tape. (O/D is to install tape 12" below final grade.)

Pulaski Electric System  
 Typical 1-Phase Primary Duct & Riser

revised March 2010